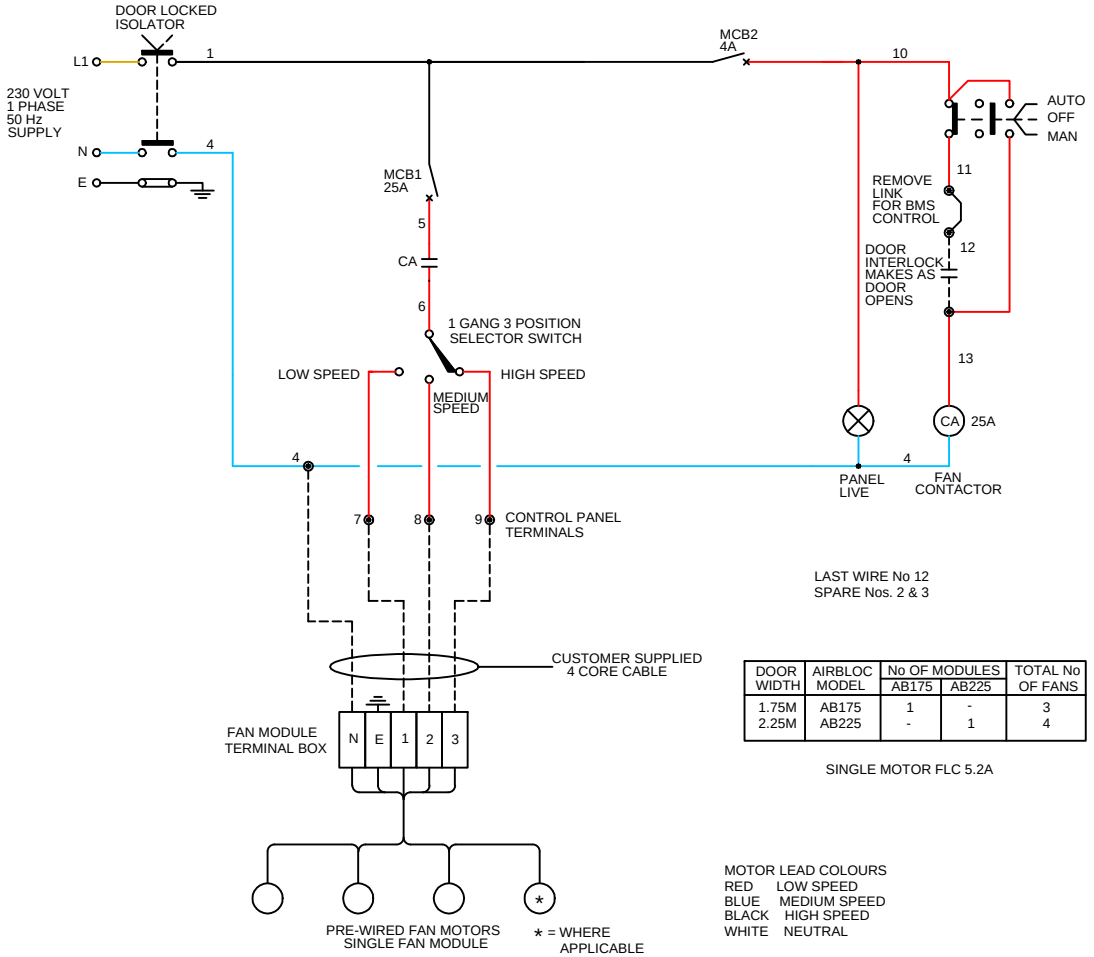

DOOR WIDTH	AIRBLOC MODEL	No OF MODULES		TOTAL No OF FANS
		AB175	AB225	
1.75M	AB175	1	-	3
2.25M	AB225	-	1	4

SINGLE MOTOR FLC 5.2A

REV	DATE	DESCRIPTION
2	23/03/18	MCB AND CONTACTOR CHANGED
1	22/12/15	MAINS ISOLATOR SWITCHED NEUTRAL

Wiring Colour Scheme
Phases.....: Black
Control 230V.....: Red
Neutral.....: Light Blue
24 VAC.....: Violet
24 VAC Ground.: White
24 VDC.....: Dark Blue
0-10 VDC.....: Orange
Analogue Inputs: Grey

TITLE: SCHEMATIC WIRING DIAGRAM FOR AMBIENT SINGLE MODULE DOOR CURTAINS 230v 1PH+N SUPPLY

CLIENT: STANDARD

DRAWN	SH
DATE	12/09/12
CHECKED	JC
APPROVED	

Fens Pool Avenue
Brierley Hill
West Midlands DY5
1QA
Tel: 01384 489 700
Fax: 01384 489 707

NORTEK GLOBAL HVAC

JOB No: STANDARD

DRAWING No: CP-AB-AMB-SINGLE R2

REVISION 2

SHEET 1 of 1